


REQUIRED SIDEWALK WIDENING AROUND OBSTRUCTIONS

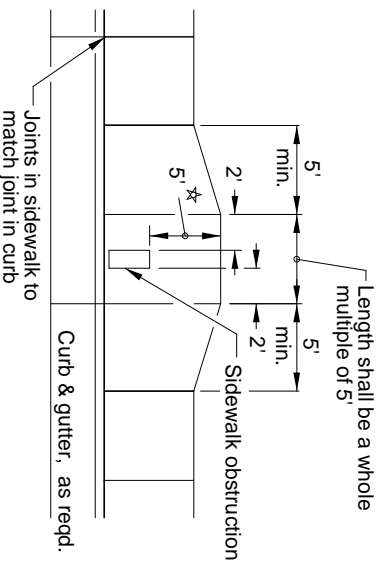


* When site constraints prohibit a 5' passage, the Engineer may direct this to be reduced, but no less than 3'.

General notes:

1. Include additional paved or unpaved 2' clearance to vertical faces higher than 5' such as retaining walls, sound walls, fences and buildings.
2. On sidewalks 8' and wider, provide a longitudinal joint at the midpoint.
3. Install 3" pvc weephole pipes in sidewalks in locations as directed by engineer. Place contraction joint over top of pipe.

CLEAR CIRCULATION PATH

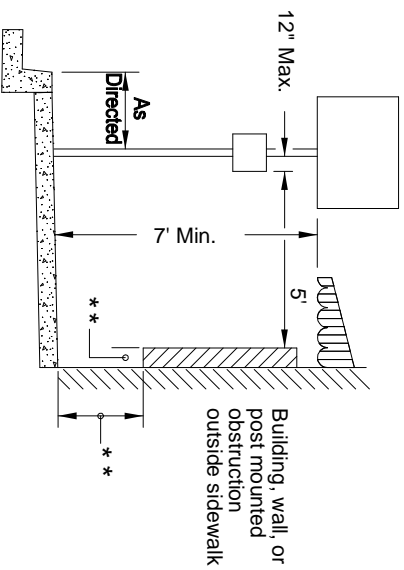

* * Objects with base below 2' 4" may protrude any distance as long as the 5' circulation path is maintained. When an object with a base higher than 2' 4" protrudes further than 4" provide a curb below protrusion to delineate edge.

The selection and use of this Standard Drawing, while designed in accordance with generally accepted engineering principles and practices, is the sole responsibility of the user and should not be used without consulting a Registered Professional Engineer.

OREGON STANDARD DRAWINGS CITY OF HOOD RIVER SIDEWALK OBSTRUCTION STANDARDS

NOTE: All material and workmanship shall be in accordance with the current Oregon Standard Specifications	REVISIONS
DATE	DESCRIPTION
12 - 02	City of Hood River Modifications
	2002