


TYPICAL PLAN VIEW - CURB SIDEWALK

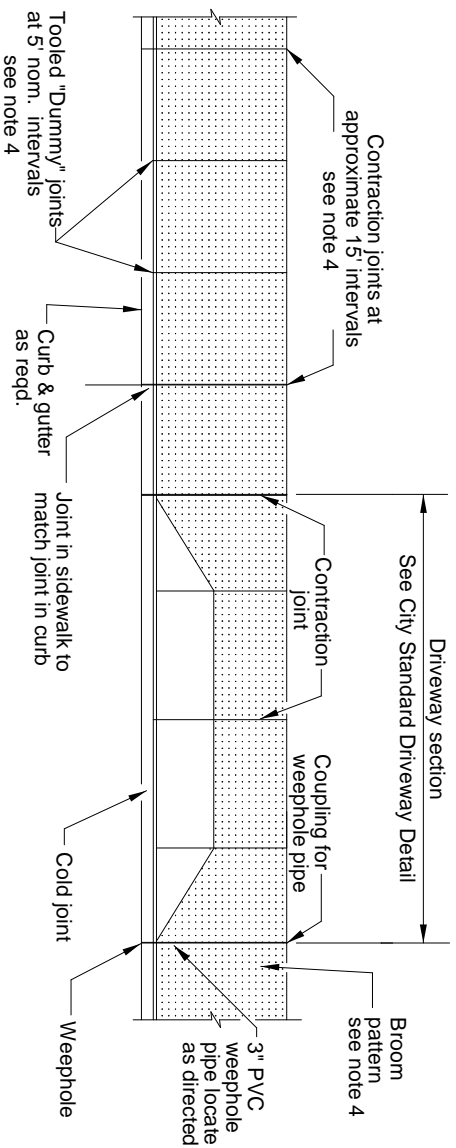

TYPICAL CURB SIDEWALK CROSS SECTION

* As specified in plans. Minimum 4" If sidewalk is a portion of a driveway or mountable curb is used minimum thickness 6".

General notes:

1. Include additional paved or unpaved 2' clearance to vertical faces higher than 5' such as retaining walls, sound walls, fences and buildings.
2. On sidewalks 8' and wider, provide a longitudinal joint at the midpoint.
3. Install 3" pvc weephole pipes in sidewalks in locations as directed by engineer. Place contraction joint over top of pipe.
4. Finish shall be medium broom with no shine marks.

<p>NOTE: All material and workmanship shall be in accordance with the current Oregon Standard Specifications</p>	
<p>OREGON STANDARD DRAWINGS CITY OF HOOD RIVER CURBSIDE SIDEWALK</p>	
DATE	REVISIONS
12-102	2002
<p>City of Hood River Modifications</p>	
<p>Registered Professional Engineer</p>	